



Refresh Home Lock Info


Example Graphic Guest Rooms AHU1

User: admin
30-Apr-26 1:52 PM BST

Alarms 0 History
0.0 °C OAT

- Menu
- Guest Rooms AHU1
- Kitchen AHU2
- Restaurant AHU3
- Staff Areas AHU4
- Corridor AHU5
- Function Room AHU6
- Dantherm Pool AHU
- Cold Water Services
- Heating System
- DHWS
- Pool Water Heating
- Extract Fans
- 4th Floor Plan
- 3rd Floor Plan
- 2nd Floor Plan
- 1st Floor Plan
- Ground Floor Plan
- Basement Floor Plan
- Sub-Basement Floor Plan
- Fire Zones / Smoke Extract
- Users
- Histories

Fire Alarm Active

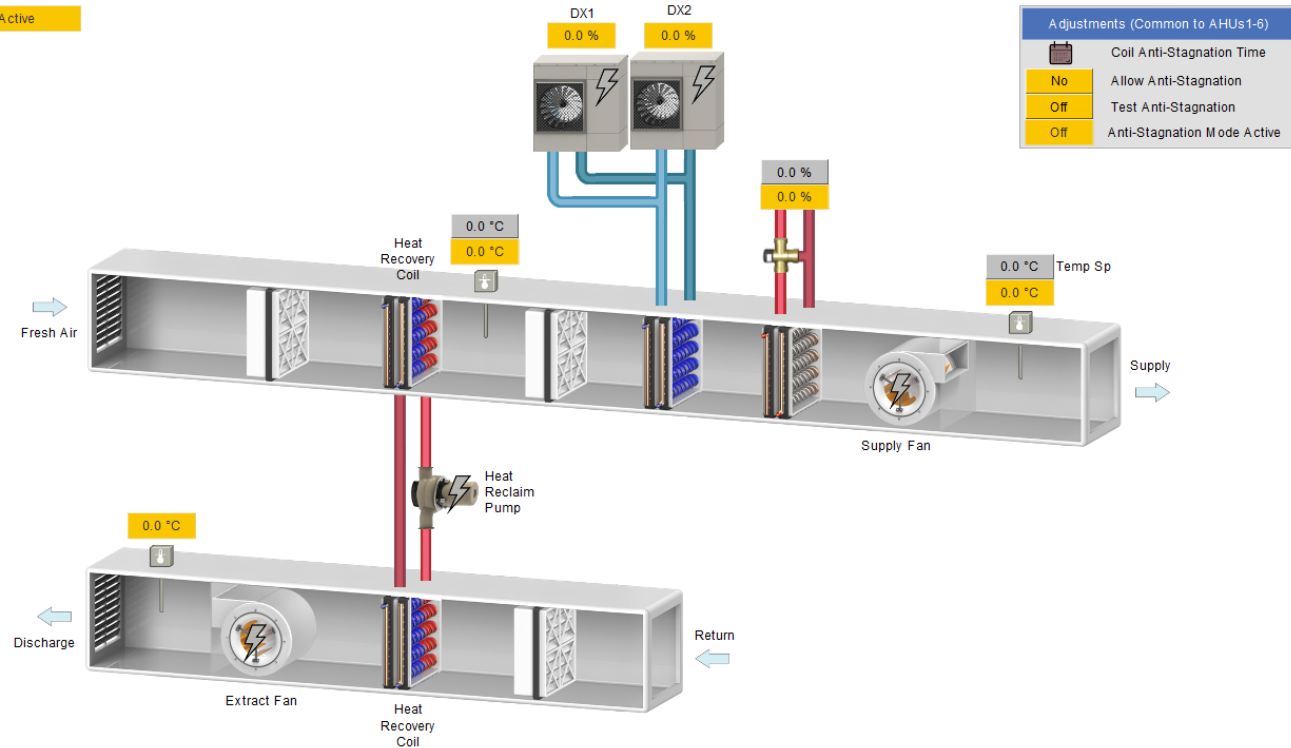




Example Graphic
Dantherm Pool AHU

User: admin
 30-Apr-26 1:53 PM BST
 Alarms 0
 History
 0.0 °C OAT

- Menu
- Guest Rooms AHU1
- Kitchen AHU2
- Restaurant AHU3
- Staff Areas AHU4
- Corridor AHU5
- Function Room AHU6
- Dantherm Pool AHU**
- Cold Water Services
- Heating System
- DHWS
- Pool Water Heating
- Extract Fans
- 4th Floor Plan
- 3rd Floor Plan
- 2nd Floor Plan
- 1st Floor Plan
- Ground Floor Plan
- Basement Floor Plan
- Sub-Basement Floor Plan
- Fire Zones / Smoke Extract
- Users
- Histories

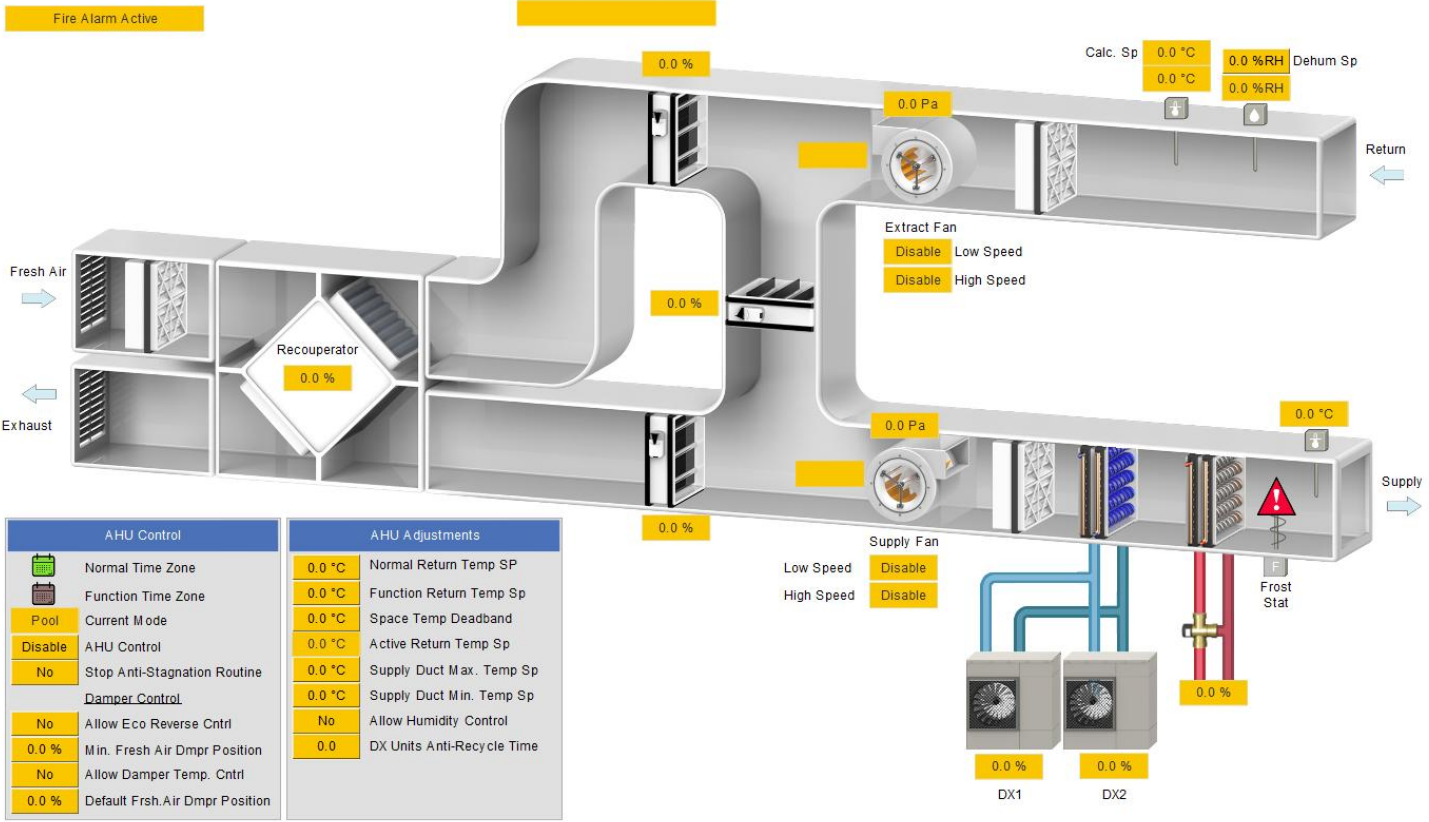



Example Graphic Basement AHU


User: admin
30-Apr-26 1:59 PM BST

Alarms 0
History

0.0 °C OAT

- Menu
- Restaurant-Kitchen AHU
- Basement AHU
- Ground Floor AHU
- Bedroom AHU1
- Bedroom AHU2
- Corridor AHU1
- Corridor AHU2
- Theatres AHU
- Extract Fans
- Door Curtain Heaters
- Basement Heating System
- Roof Heating System
- Smoke Extract Fans
- Roof Floor Plan
- Ground Floor Plan
- Basement Floor Plan
- Users
- Histories

Fire Alarm Active

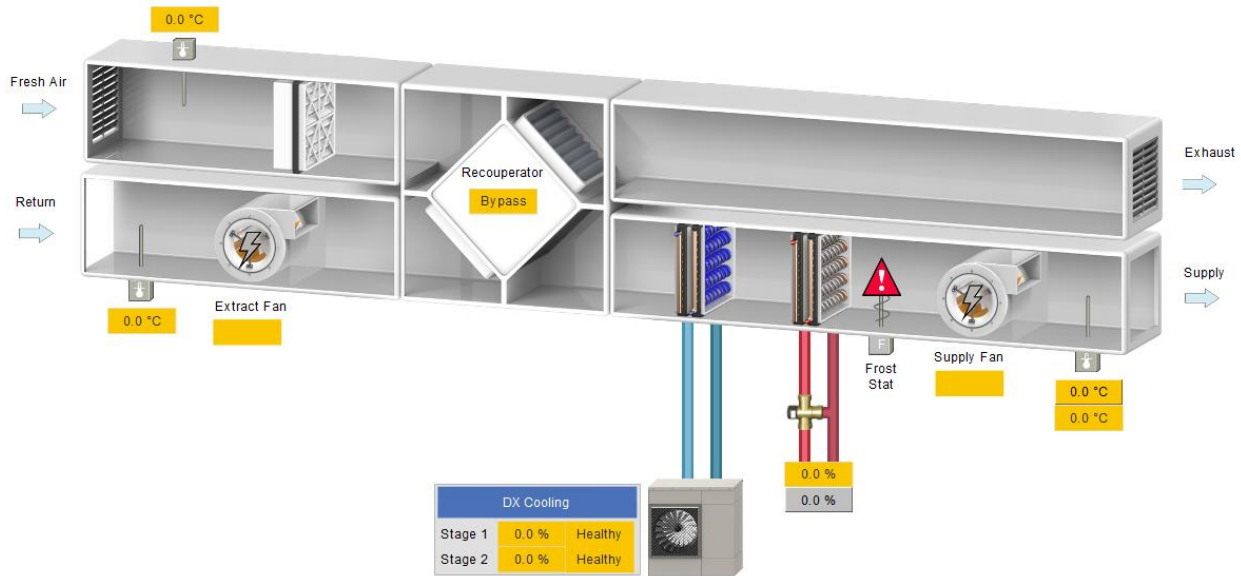



Refresh Home Lock Info

Example Graphic Theatres AHU

User: admin
30-Apr-26 2:00 PM BST


Alarms 0 History
0.0 °C OAT

- Menu
- Restaurant-Kitchen AHU
- Basement AHU
- Ground Floor AHU
- Bedroom AHU1
- Bedroom AHU2
- Corridor AHU1
- Corridor AHU2
- Theatres AHU
- Extract Fans
- Door Curtain Heaters
- Basement Heating System
- Roof Heating System
- Smoke Extract Fans
- Roof Floor Plan
- Ground Floor Plan
- Basement Floor Plan
- Users
- Histories

Fire Alarm Active

Theatre 1
UnOcc
0.0 °C
0.0 °C

Theatre 2
UnOcc
0.0 °C
0.0 °C

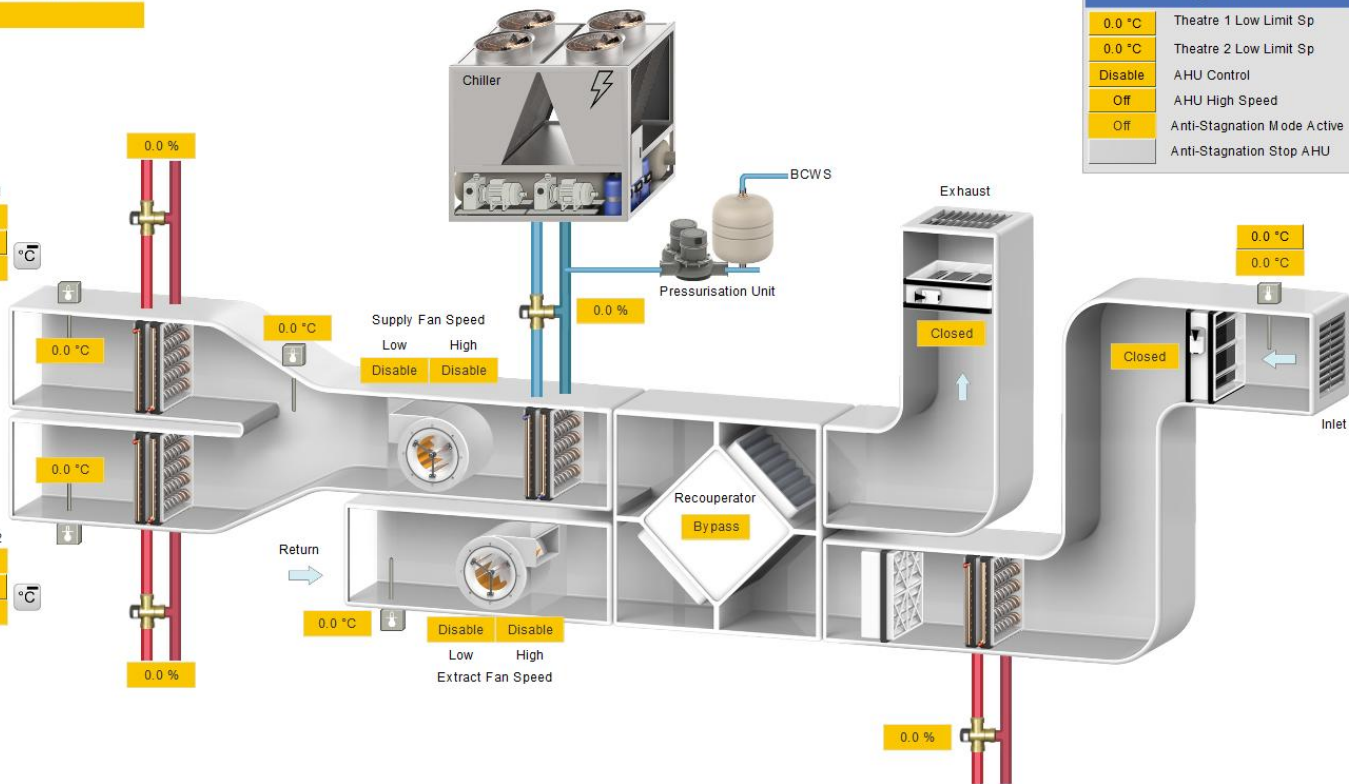

Adjustments	
0.0 °C	Theatre 1 Low Limit Sp
0.0 °C	Theatre 2 Low Limit Sp
Disable	AHU Control
Off	AHU High Speed
Off	Anti-Stagnation Mode Active
	Anti-Stagnation Stop AHU




Refresh Home Lock Info icons

Example Graphic Heating System

User: admin 30-Apr-26 1:53 PM BST Alarms 0 History 0.0 °C OAT

- Menu
- Guest Rooms AHU1
- Kitchen AHU2
- Restaurant AHU3
- Staff Areas AHU4
- Corridor AHU5
- Function Room AHU6
- Dantherm Pool AHU
- Cold Water Services
- Heating System
- DHWS
- Pool Water Heating
- Extract Fans
- 4th Floor Plan
- 3rd Floor Plan
- 2nd Floor Plan
- 1st Floor Plan
- Ground Floor Plan
- Basement Floor Plan
- Sub-Basement Floor Plan
- Fire Zones / Smoke Extract
- Users
- Histories

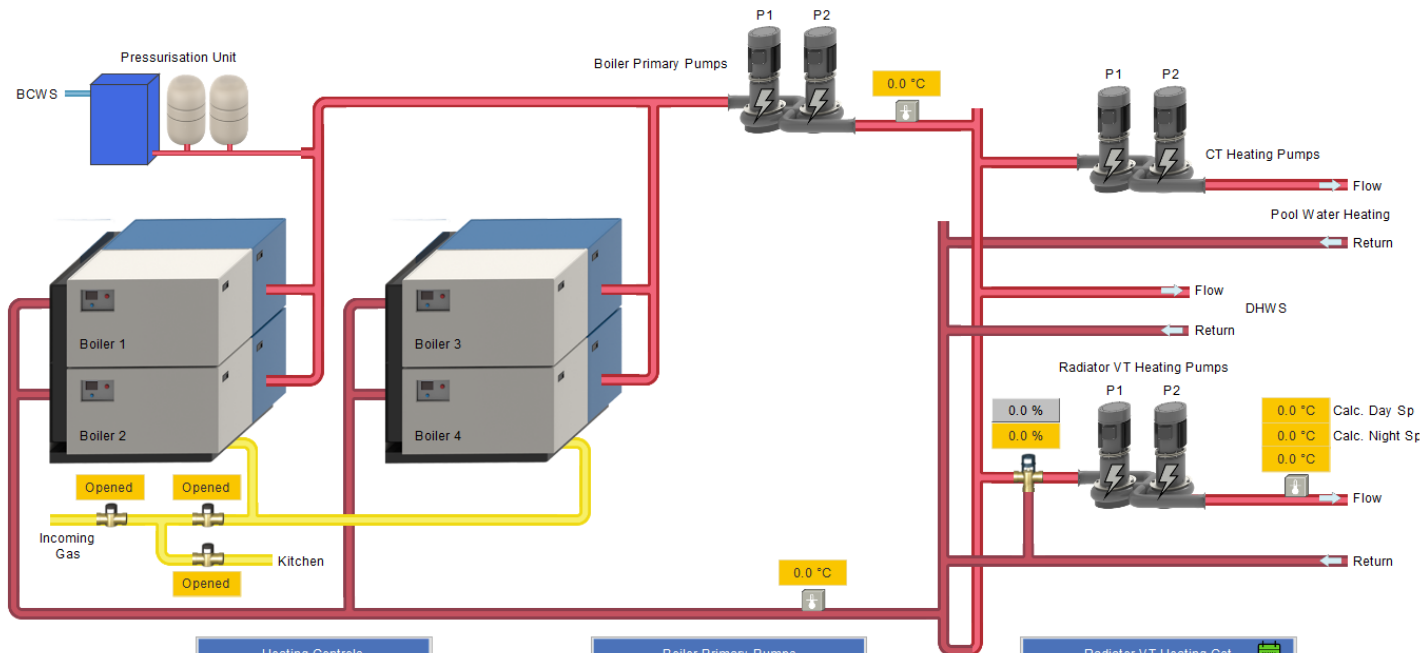

Heating Controls

- 0.0 °C OAT Hold Off Temp Sp
- 0.0 mo Winter Start Month
- 0.0 mo Winter Stop Month
- Off Year Round Heating
- In Auto Winter Mode

Boiler Primary Pumps

- Reset Pumps Fail Reset

CT Heating Pumps

- Reset Pumps Fail Reset

Radiator VT Heating Cct

- 0.0 °C VT Flow Temp Sp @ 20C
- 0.0 °C VT Flow Temp Sp @ 0C
- 0.0 °C VT Night Setback Sp
- Reset Pumps Fail Reset

??martin strat??




Example Graphic DHWS

User: admin
30-Apr-26 1:53 PM BST

Alarms 0
History

0.0 °C OAT

- Menu
- Guest Rooms AHU1
- Kitchen AHU2
- Restaurant AHU3
- Staff Areas AHU4
- Corridor AHU5
- Function Room AHU6
- Dantherm Pool AHU
- Cold Water Services
- Heating System
- DHWS**
- Pool Water Heating
- Extract Fans
- 4th Floor Plan
- 3rd Floor Plan
- 2nd Floor Plan
- 1st Floor Plan
- Ground Floor Plan
- Basement Floor Plan
- Sub-Basement Floor Plan
- Fire Zones / Smoke Extract
-
-
-
-
- Users
- Histories

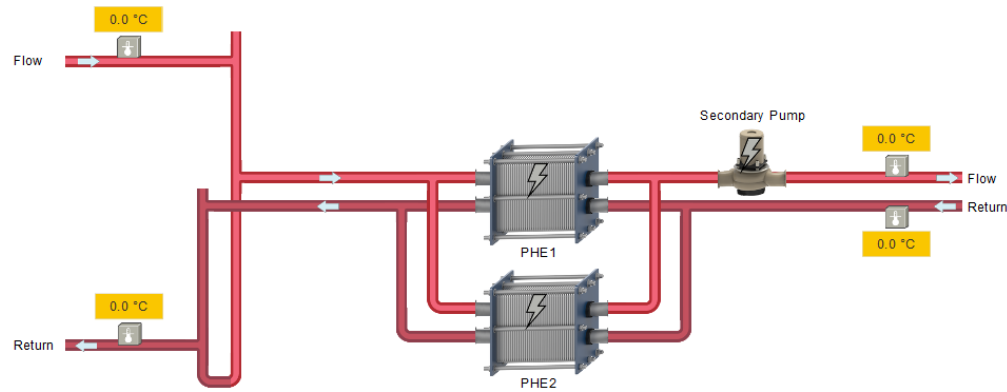



Login History

Example Graphic

Barn 2 Switchroom

Audit History

User: admin
30-Apr-26 1:58 PM BST

Alarms
History

0.0 °C OAT

